

GE APPLIANCES

Product Specifications

NS15A*5

SINGLE STAGE SPLIT SYSTEM AIR CONDITIONER -R454B








READ CAREFULLY. KEEP THESE INSTRUCTIONS.

31-5000961 Rev. 0 02-25

NS15A*5 PRODUCT SPECIFICATIONS

MODEL NUMBER GUIDE

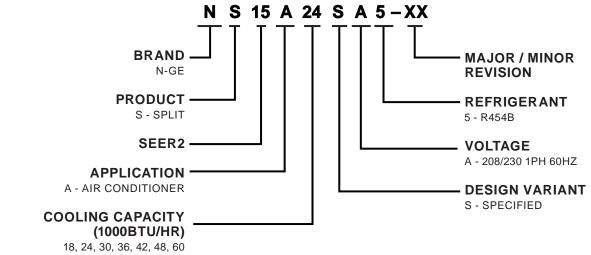

APPROVALS

- AHRI Standard 210-240-2023 certified
- AHRI Certified system match-ups and expanded ratings, visit AHRIDirectory.org
- ENERGY STAR® Certified
- · Sound rated to AHRI Standard 270-2008 test conditions
- Region specific models meet the minimum efficiency requirements for U.S. DOE Federal Regional Standards in that area
- ETL certified (U.S. and Canada)
- ISO 9001 Registered Manufacturing Quality System

APPLICATIONS

- 1.5 to 5 ton
- Sound levels as low as 73 dBA
- · Single phase power supply
- Vertical air discharge
- · Applicable to indoor air handlers or gas furnaces with indoor add-on coils
- · Factory test operated

REFRIGERANT SYSTEM

R-454B Refrigerant

- Low GWP (Global Warming Potential)
- Zero ODP (Ozone Depletion Potential)
- · Unit is factory pre-charged

Outdoor Coil Fan

- Direct drive fan
- Vertical air discharge
- Totally enclosed fan motor
- Sleeve bearings (018 through 048 and 060 models)
- Inherently protected
- · Motor rain shield

Corrosion Resistant Coil

- Enhanced aluminum alloy tube/enhanced fin coil
- Superior corrosion resistance
- Ripple-edged aluminum fins
- Aluminum tube construction
- Lanced fins for maximum fin surface exposure
- Factory tested under high pressure
- · Entire coil is accessible for cleaning

High Capacity Liquid Line Drier

- Furnished with unit for field installation
- · Drier traps moisture or dirt that could contaminate the system
- 100% molecular-sieve, bead type, drier

High Pressure Switch

- Protects the system from high pressure conditions that can be a result of fan failure or a blocked/dirty coil
- Manual reset

Low Pressure Switch

- · Shuts off unit if suction pressure falls below setting
- Provides loss of charge and freeze-up protection
- Automatic reset

REFRIGERANT SYSTEM (CONT)

OPTIONAL ACCESSORIES

Expansion Valve Kits

- Factory installed with R-454B on all Indoor units
- See TXV Usage table
- · Chatleff style fitting

Freezestat

- Senses suction line temperature
- · Cycles compressor off when suction line temperature falls below freezestat setpoint
- Opens at 29°F and closes at 58°F
- Installs on or near the discharge line of the evaporator or on the suction line

Loss of Charge Switch Kit

- · Protects compressor from damage from low refrigerant charge conditions
- SPST, normally-closed
- Automatic reset

INDOOR REFRIGERANT DETECTION SYSTEM (RDS)

- Complies with UL 60335-2-40 approved standard
- Required for all systems using R-454B refrigerant
- · Factory or field installed on all indoor units
- · Consists of a RDS refrigerant detection sensor and an independent RDS control
- If refrigerant is detected the refrigerant detection system will prevent compressor and heating operation until refrigerant is no longer detected
- Refrigeration detection system also energizes the blower if refrigerant is detected to dissipate any concentrations of refrigerant from the space
- · Refer to indoor unit Product Specifications documents for additional details

COMPRESSOR

Single Stage Scroll Compressor

- High volumetric efficiency
- · Uniform suction flow
- Constant discharge flow
- High efficiency
- Quiet operation
- Low gas pulses during compression reduces operational sound levels
- · Compressor motor is internally protected from excessive current and temperature
- Muffler in discharge line reduces operating sound levels
- · Compressor is installed in the unit on resilient rubber mounts for vibration free operation

Compressor Crankcase Heater (048 and 060 Models)

• Prevents migration of liquid refrigerant into compressor and ensures proper compressor lubrication

COMPRESSOR (CONT)

OPTIONAL ACCESSORIES

Compressor Crankcase Heater (018, 024, 030, 036 and 042 Models)

• Prevents migration of liquid refrigerant into compressor and ensures proper compressor lubrication

Compressor Sound Cover

- · Polymer outer shell
- 1-1/2 inch thick batt fiberglass insulation
- All open edges are sealed with a one-inch wide hook and loop fastening tape

Compressor Hard Start Kit

- Single-phase units are equipped with a PSC compressor motor
- This type of motor normally does not need a potential relay and start capacitor
- For conditions such as low voltage, kit may be required to increase the compressor starting torque

Compressor Low Ambient Cut-Off

- · Non-adjustable switch (low ambient cut-out)
- · Prevents compressor operation in cooling mode when outdoor temperature is below 35°F

Compressor Time-Off Control

- · Kit prevents compressor short-cycling
- Allows time for suction and discharge pressure to equalize.
- Permits compressor start-up in an unloaded condition.
- Automatic reset with 5 minute delay between compressor shut-off and start-up

Indoor Blower Off Delay Relay Kit

· Delays the indoor blower-off time during the cooling cycle

Low Ambient Kit

- Heat pump can operate in the cooling mode down to 45°F outdoor air temperature without additional controls
- Allows unit to operate properly down to 30°F in the cooling mode

NOTE - Crankcase heater and freezestat should be installed on compressors equipped with a low ambient kit. **NOTE** - A compressor lock-out thermostat should be added to terminate compressor operation below recommended operation conditions.

CABINET

- Heavy gauge steel cabinet
- Louvered heavy gauge steel panels surround unit on all four sides
- Pre-painted cabinet finish
- · Control box conveniently located with all controls factory wired
- Corner patch plate allows access to compressor components
- Drainage holes provided in base section for moisture removal

Refrigerant Line Connections, Electrical Inlets, Service Valves

- · Sweat connection vapor and liquid lines
- · Located on corner of unit cabinet
- Suction valve can be fully shut off, while liquid valve may be front seated to manage refrigerant charge while servicing system
- · Refrigerant line connections and field wiring inlets are located in one central area of cabinet for easy access
- See dimension drawing

Braze-Free/Press Fitting Flexibility

· Units can accommodate braze-free or press fittings for installation versatility

SINGLE STAGE AIR CONDITIONER

SPECIFICATIONS	5							
Size			018 024 030 0					
Nominal Tonnage			1.5	1.5 2 2.5 3				
Sound Rating Numbe	r	dBA	73		76			
Connections (Sweet)		Liquid line (OD) - in.	3/8					
Connections (Sweat)		Suction line (OD) - in.		3	/4			
Compressor Type				1-Stag	e Scroll			
Refrigerant Type		¹ R-454B charge furnished	4 lbs. 0 oz.	4 lbs. 7 oz.	4 lbs. 14 oz.	5 lbs. 10 oz.		
Indoor Unit Expansio	n Valve (TXV)			262	Z70			
		Net face area - ft. ²	11.33	13.22	16.33	18.67		
Outdoor Coil		Tube diameter - in.		5/16				
		Rows	1.5 2 2 dBA 73 3/8 0) - in. $3/8$ a) - in. $3/4$ 1-Stage Scroll bished 4 lbs. 0 oz. 4 lbs. 7 oz. 4 lbs. 0.1.5 26Z70 a - ft.2 11.33 13.22 16 ar - ft.2 11.33 13.22 16 er - in. $5/16$ 5 1 Rows 1 1 1 1 sr - in 26 1 1 1 Bades 3 3 3 3 3 Cfm 2290 2350 26 26 Rpm 1075 1 1 1 watts 150 155 1 1 se-Hz) 208/230-1-60 22 2 2 (unit) 11.1 13.5 10 2 2 (unit) 15 20 2 2 2 2 gamps 8.3 10.2 1 3 3 3 <td< td=""><td>1</td><td></td></td<>	1				
		Fins - in		2	2.5 76 3/8 3/4 age Scroll 4 lbs. 14 oz. 26Z70 16.33 5/16 1 25 1 1 25 1 26 1 25 1 1 25 1 26 1 25 1 6 1 25 1 6 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 25 1 6 7 8 1 7 8 1 7 8 1 7 8 1 7 8 1 7 7 8 1 7 7 8 7 7 7 7 7 7 7 7 7 7 7 7 7			
		HP	1/	10	1/6			
		Diameter - in.	18 22			.2		
Outdoor Fan		Blades	3					
		Cfm	2290	2350	2610	2800		
		Rpm	1075		8	825		
		Watts	150	155	160	190		
Shipping Data - Ibs.			128	134	152	161		
ELECTRICAL DA	ТА							
	Lin	e voltage data (Volts-Phase-Hz)	208/230-1-60					
² Maximum overcurrent protection (MOCP) amps (unit)			15	20	25	30		
³ Minimum circuit ampacity (MCA) (unit)			11.1	13.5	16.6	17.8		
Comprosect		Rated load amps	8.3	10.2	12.5	13.4		
Compressor		Locked rotor amps	45	60.2	67.8	82.5		
Fan Motor		Full load amps	0.	65	1.0			
		Locked rotor amps	1	.3	1	.9		

OPTIONAL ACCESSORIES - ORDER SEPARA	TELY				
Accessory	Part No.	018	024	030	036
Compressor Crankages Hester	27V63	٠	•	•	•
Compressor Crankcase Heater	27U16	•	•	•	•
	63W22	•			
Compressor Hard Start Kit	10J42		•	•	•
-	10J42	•	•	•	•
Compressor Low Ambient Cut-Off Switch	48F08	•	•	•	•
Compressor Timed-Off Control	47J27	•	•	•	•
Compressor Sound Cover	18J42	٠	•	•	•
Freezestat - 3/8 in.	93G35	٠	•	•	•
Indoor Blower Off Delay Relay	58M81	٠	•	•	٠
Loss of Charge Switch Kit	84M23	٠	•	•	٠
⁴ Low Ambient Kit (Fan Cycling)	34M72	•	•	•	•


NOTE - Extremes of operating range are plus 10% and minus 5% of line voltage. ¹ Refrigerant charge is sufficient for 15 ft. length of refrigerant lines. For longer line set requirements see the Installation Instructions for information about line set length and additional refrigerant charge required.


¹ HACR type breaker or fuse.
³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.
⁴ Crankcase Heater and Freezestat are recommended with Low Ambient Kit.

SPECIFICATI	ONS					
Size			042	048	060	
Nominal Tonnag	e		3.5	4	5	
Sound Rating N	umber	dBA	76	78	80	
Compositions (Cu		Liquid line (OD) - in.		3/8		
Connections (Sv	veat)	Suction line (OD) - in.	3/4	7/8	1-1/8	
Compressor Typ	e			1-Stage Scroll		
Refrigerant Type	•	¹ R-454B charge furnished	6 lbs. 2 oz.	7 lbs. 10 oz.	8 lbs. 8 oz.	
Indoor Unit Expa	ansion Valve (TXV)		26	Z71	26Z72	
	Net face area - ft.2	Outer coil	21.00	16.33	21.00	
		Inner coil		16.33	20.25	
Outdoor Coil		Tube diameter - in.		5/16		
		Rows	1		2	
		Fins - in	26	2	2	
		HP	1/3	1,	/4	
		Diameter - in.		22		
Outdoor Fan		Blades	:	3	4	
Outdoor Fan		Cfm	2985	2875	3250	
		Rpm	8	25	845	
		Watts	150	150 160		
Shipping Data -	lbs.		195	215	250	
ELECTRICAL	DATA					
	Line	voltage data (Volts-Phase-Hz)	208/230-1-60			
2	Maximum overcurrent p	protection (MOCP) amps (unit)	35	40	50	
	³ Minimur	n circuit ampacity (MCA) (unit)	21.2	24.3	31.3	
0		Rated load amps	14.9	18.0	23.7	
Compressor		Locked rotor amps	109	126	157	
For Motor		Full load amps	2.6	1	.7	
Fan Motor		Locked rotor amps		3	.2	
OPTIONAL ACCI	ESSORIES - ORDER S	EPARATELY				
	Accessory	Part No.	042	048	060	
	.	27P59	٠	_		
Compress	or Crankcase Heater	27U16	•	Factory	Installed	
		10J42	•	•	•	
Compres	ssor Hard Start Kit	88M91	•	•	•	
Compressor Lo	w Ambient Cut-Off Swi		•	•	•	
	ssor Sound Cover	18J42	•			
Compressor Timed-Off Control 47J27			•	•	•	
-	ezestat - 3/8 in	93G35	•	•	•	
1100		58M81	•	•	•	
	wer On Delay Relav	001101				
Indoor Blo	wer Off Delay Relay Charge Switch Kit	84M23	•	•	•	

NOTE - Extremes of operating range are plus 10% and minus 5% of line voltage. ¹ Refrigerant charge is sufficient for 15 ft. length of refrigerant lines. For longer line set requirements see the Installation Instructions for information about line set length and additional refrigerant charge required. ² HACR type breaker or fuse. ³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. ⁴ Crankcase Heater and Freezestat are recommended with Low Ambient Kit.

DIMENSIONS - UNIT

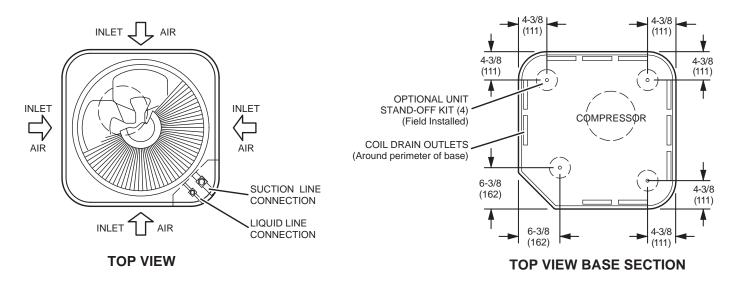

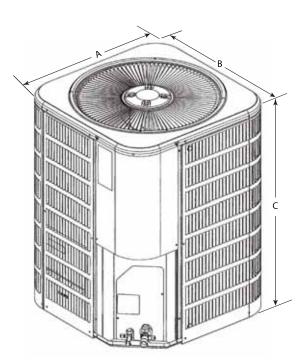

Size		A, B Width and Depth		C Height
	In.	mm	in.	mm
018	24-1/4	616	25-1/4	641
024	24-1/4	616	29-1/4	743
030	28-1/4	718	29-1/4	743
036	28-1/4	718	33-1/4	845
042	28-1/4	718	37-1/4	946
048	28-1/4	718	29-1/4	743
060	28-1/4	718	37-1/4	946


EXPANDED SOUND DATA													
Octave Band Sound Power Levels dBA, re 10- ¹² Watts Center SIZE Frequency - HZ				¹ Sound Rating	² Estimated Sound Pressure Level at Distance From Unit (dBA at distance in ft.)								
	125	250	500	1000	2000	4000	8000	Number (dBA)	3	5	10	15	50
18	53	58.5	66.5	69.5	65	62.5	54.5	73	66	61	55	52	41
24	56	66	72	71	67	63	56.5	76	69	64	58	55	44
30	55	64.5	70.5	72.5	67.5	61	54	76	69	64	58	55	44
36	58	67.5	71.5	70.5	66.5	61.5	55	76	69	64	58	55	44
42	56	65	71	71.5	67.5	62	55	76	69	64	58	55	44
48	61.5	68	73.5	72.5	69	64	56.5	78	71	66	60	57	46
60	63.5	70	75	75	70.5	68	61	80	73	68	62	59	48

NOTE - the octave sound power data does not include tonal correction.

¹ Tested according to AHRI Standard 270-2008 test conditions.

² Estimated sound pressure level at distance based on AHRI Standard 275-2010 method for equipment located on the ground, roof, or on side of building wall with no adjacent reflective surface within 9.8 feet. Sound pressure levels will increase based on changes to assumptions. For other applications, refer to AHRI Standard 275.

FIELD WIRING

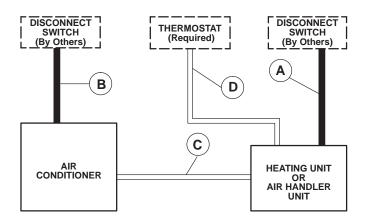

A - Two Wire Power (not furnished). See Indoor Unit Electrical Data

B - Two Wire Power (not furnished). See Electrical Data

C - Four Wire Low Voltage (not furnished). 18 ga. minimum


D - Five Wire Low Voltage (not furnished). 18 ga. minimum

All wiring must conform to NEC or CEC and local electrical codes.

INSTALLATION CLEARANCES

NOTES:

- Service Clearance 30 in. (762 mm) must be maintained on one of the sides adjacent to the control box
- Clearance to one of other three sides must be 36 in. (914 mm).
- Clearance to one of the remaining two sides may be 12 in. (305 mm). and the final side may be 6 in. (152 mm).
- A clearance of 24 in. must be maintained between two units .48 in. (1219 mm) clearance required on top of unit.



TXV USAGE

All **GE Appliances** coils and air handlers are shipped with a factory installed TXV. In most cases, no substitution is needed.

If a different size TXV is required, it will be listed in the **TXV SUBSTITUTION** table by size. The correct TXV must be ordered separately and field installed.

Size	Order No.	
018	26Z70	
024	26Z70	
030	26Z70	
036	26Z70	
042	26Z71	
048	26Z71	
060	26Z72	

AHRI STANDARD 210-240-2023

Cooling or heating capacities are net values, including the effects of blower motor heat, and do not include supplementary heat. Power input is the total power input to the compressor(s) and fan(s), plus any controls and other items required as part of the system for normal operation.

Units which do not have an indoor air-circulating blower furnished as part of the model, i.e., split system with indoor coil only, is established by subtracting from the total cooling capacity 1250 Btu/h per 1,000 cfm, and by adding the same amount to the heating capacity.

Total power input for both heating and cooling is increased by 365 W per 1,000 cfm of indoor air circulated.

TXV SUBSTITUTION - R-454B

A general guide for replacing the factory installed R-454B TXV if the indoor unit (coil/air handler) is larger or smaller than the outdoor unit.

Outdo	tdoor Unit Indoor Unit		TXV	ТХУ		
Size	Tons	Size	Tons	Furnished	Replacement	
		42	3.5		26Z71	
		48	4			
040	4.5	49	4			
018	1.5	50/60	4/5	26Z70		
		51/61	4/5		26Z72	
		60	5			
		42	3.5			
		48	4		26Z71	
024	2	49	4	00770		
024	2	50/60	5	26Z70		
		51/61	5		26Z72	
		60	5			
		42	3.5			
		48	4	26Z70	26Z71	
0.20	2.5	49	4			
030	2.5	50/60	4/5			
		51/61	4/5		26Z72	
		60	5			
		42	3.5			
		48	4		26Z71	
0.00		49	4	00770		
036	3	50/60	5	26Z70		
		51/61	5		26Z72	
		60	5			
		24	2			
0.40	25	30	2.5		00770	
042	3.5	30/36	3	26Z71	26Z70	
		36	3			
0.40	4	30/36	2.5/3	26Z71	26770	
048	4	36	3		26Z70	

TXV Ranges:

- 26Z70 1.5 to 3 ton systems Use on 3 ton (036) and lower systems.
- **26Z71** 3.5-4 ton systems Use down to 3.5 ton (042) systems.
- 26Z72 5 ton systems Use on 5 ton (060) systems only.

NOTES

